


TEST TAP

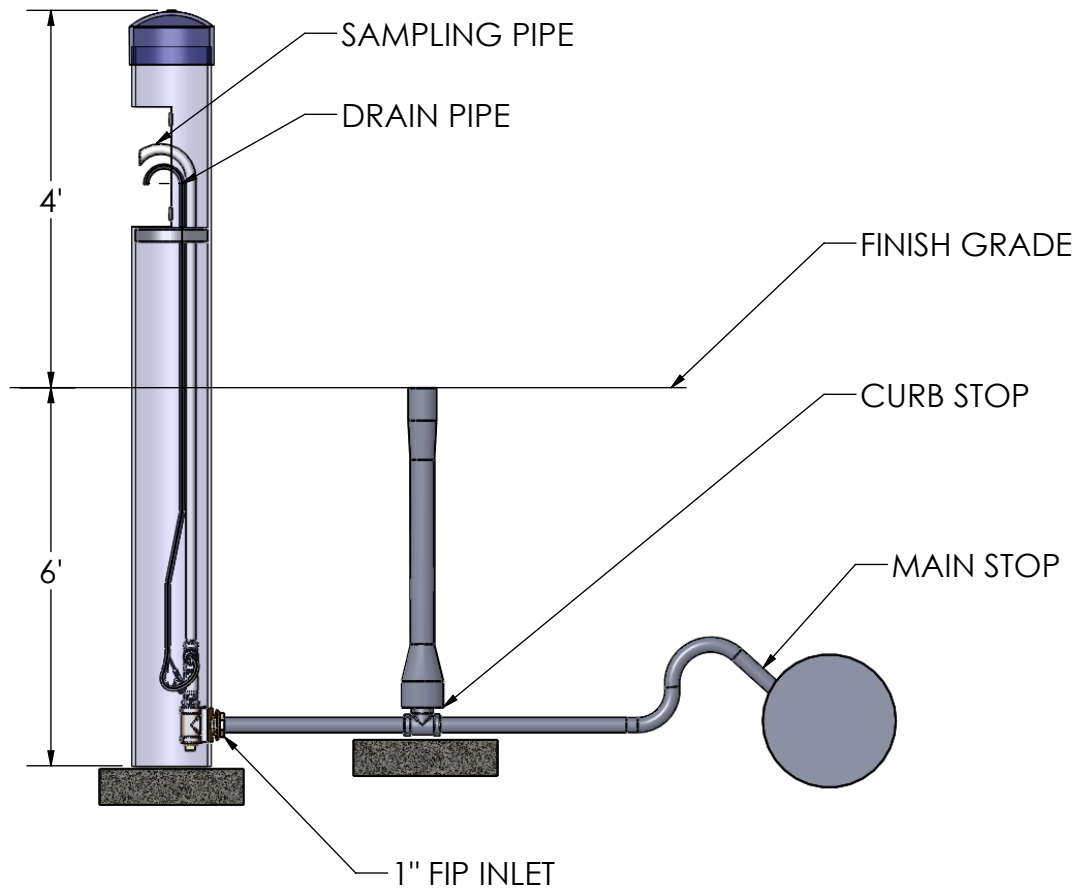

- Sampling stations shall have a 1/2" 316 stainless steel waterway. (No Lead)
- Sampling stations shall be equipped with a 3/8" 316 stainless steel vent tube. This is used to pump standing water from unit after use, preventing freezing and bacteria growth.
- The enclosure shall be made from schedule 40 PVC pipe with a lockable access door.
- The enclosure shall protect all components from corrosive soil and ground water.
- After the water is turned off at the curbstop, all working parts shall be removable without digging or the use of any tools.
- Sampling stations will be equipped with a 1" FIP inlet for the connection to the watermain.
- Standard Test Tap is designed for a 1.8 meter (6 feet) bury and a 1.2 meter (4 feet) pedestal. (Alternate lengths available)

Typical Install from Watermain to Test Tap Sampling Station

3/4" mainstop, 3/4" domestic pipe to a 3/4" curbstop, 3/4" domestic pipe to Test Tap.

Notes

1. The Test Tap should rest on a concrete slab. 30cm X 30cm Patio slab is acceptable.
2. The Curbstop should rest on a concrete slab. Small patio slab is acceptable.
3. If no-lead fittings (mainstop, curbstop etc) are used to connect the Test Tap to the watermain this would provide a complete no-lead sample point.

PROPRIETARY AND CONFIDENTIAL THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF TEST TAP. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF TEST TAP IS PROHIBITED.	COMMENTS:		NAME	DATE	SAMPLING STATION	
	APPLICATION	DO NOT SCALE DRAWING	DRAWN		SIZE	DWG. NO.
			CHECKED		A	SS1
			Q.A.		SCALE: NTS	
						SHEET 1 OF 1